


# *p/Q* closed-loop control amplifier

**RE 30058/06.12**  
Replaces: 03.04

1/14

## Type VT-VARAP1-...-2X/...

Component series 2X

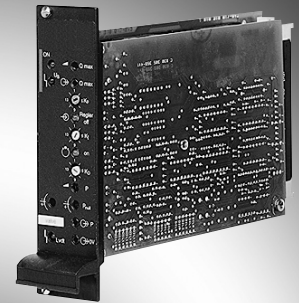

## Table of contents

Contents	Page
Features	1
Ordering code, accessories	2
Front plate	2
Block diagram with pin assignment	3, 4
Technical data	5, 6
Additional information	6
Examples	7
Function	8
Block diagram daughter card	9
Mode setting	10
General notes	11
Ideal development	12
Adjustment protocol	13
Unit dimensions	14
Project planning / maintenance instructions / additional information	14

## Features

Page	Features
1	– Suitable for controlling direct and pilot operated control valves
1	– Amplifier with additional electronics (daughter card)
2	– Analog amplifiers in Europe format for installation in 19" racks
2	– Valve position control with PID behavior
3, 4	– Pressure control with external pressure load cell
5, 6	– Controlled output stage
6	– Enable input
7	– Outputs short-circuit-proof
8	– Adjustment possibilities – Zero point valve
9	– Cable break detection for actual value cable and pressure sensor
10	– Fast energization and fast deletion for short actuating times
11	– External controller shut-off
12	– Suitable for pressure sensors (1...6 V, 0...10 V, 4...20 mA), see data sheet 30271
13	
14	

### Notice:

The photo is an example configuration.  
The delivered product differs from the figure.

### Ordering code, accessories

**VT- V A R A P 1 - -2X/V0/**

Hydraulic component (control)	
Axis control	= A
Valve type	
High-response valve	= R
Control	
Analog	= A
Function	
p/Q control	= P
Output stages	
1 output stage	= 1

no code =	High-response valve size 6/10 direct operated
5/3V =	p/Q valve size 10 direct operated
2STV =	High-response valve pilot operated
3/2V =	High-response valve pilot operated Control line A → X
V0 =	Customer version Catalog version
2X =	Component series 20 to 29 (20 to 29: Unchanged technical data and pin assignment)
527 =	Serial number for types 2.7 A solenoid
537 =	3.7 A solenoid


### Preferred types

Amplifier type	Material number	For high-response valves with electrical position feedback
VT-VARAP1-527-20/V0	0811405152	4WRPH6...
VT-VARAP1-537-20/V0	0811405153	4WRPH10...
VT-VARAP1-537-20/V0/5/3V	0811405154	5WRP10...
VT-VARAP1-527-20/V0/2STV	0811405155	4WRL...
VT-VARAP1-527-20/V0/3/2VAX	0811405156	3WRCBH25...50...

### Suitable card holder:


- Open card holder VT 3002-1-2X/32F (see data sheet 29928).
- Only for control cabinet installation!

### Front plate

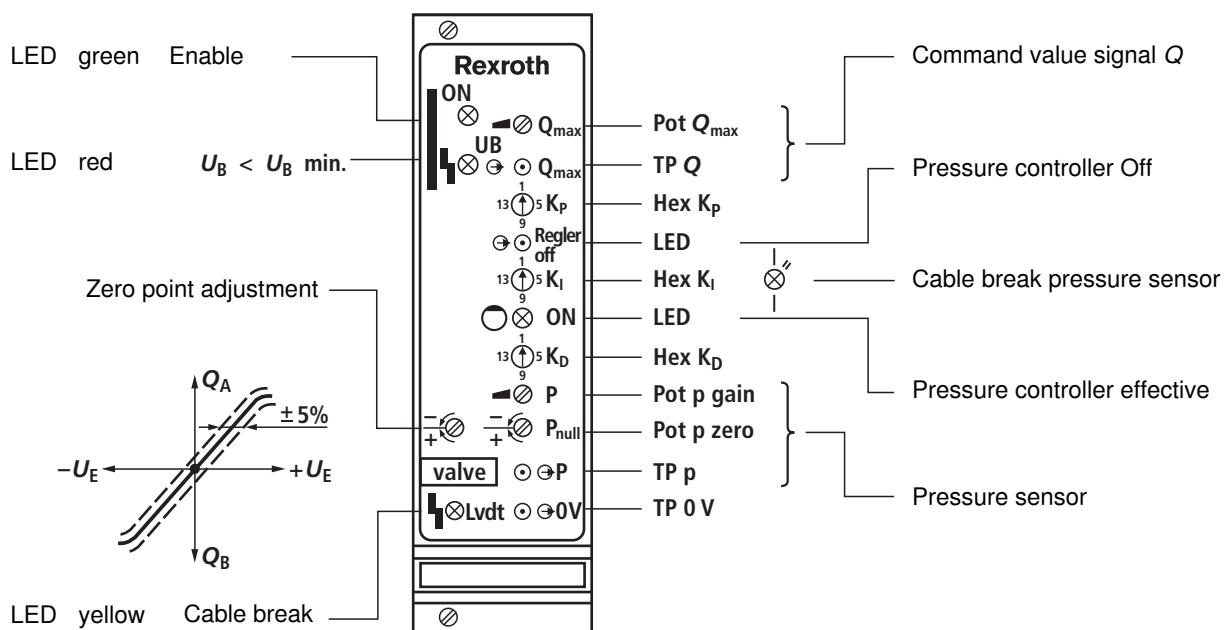


### Block diagram with pin assignment

0811405152, 0811405153, 0811405154

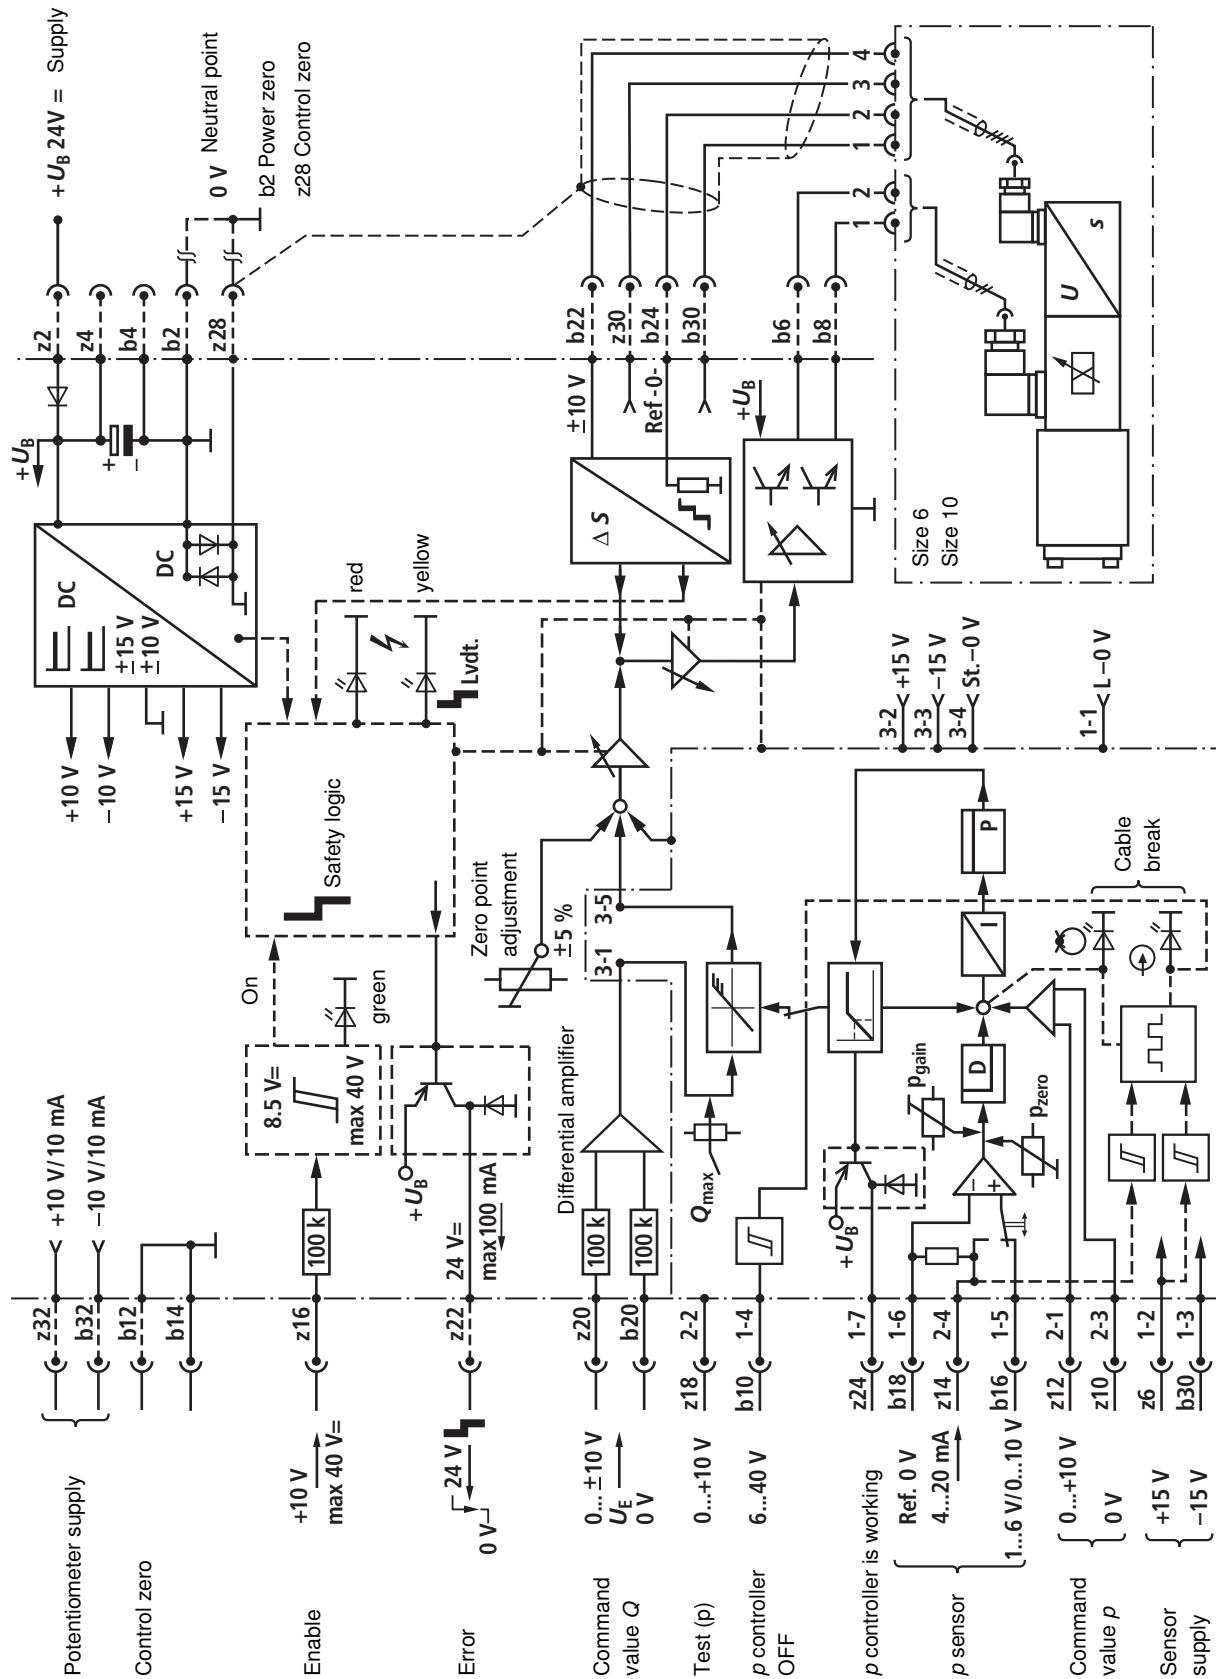

### Block diagram with pin assignment

0811405155,  
0811405156

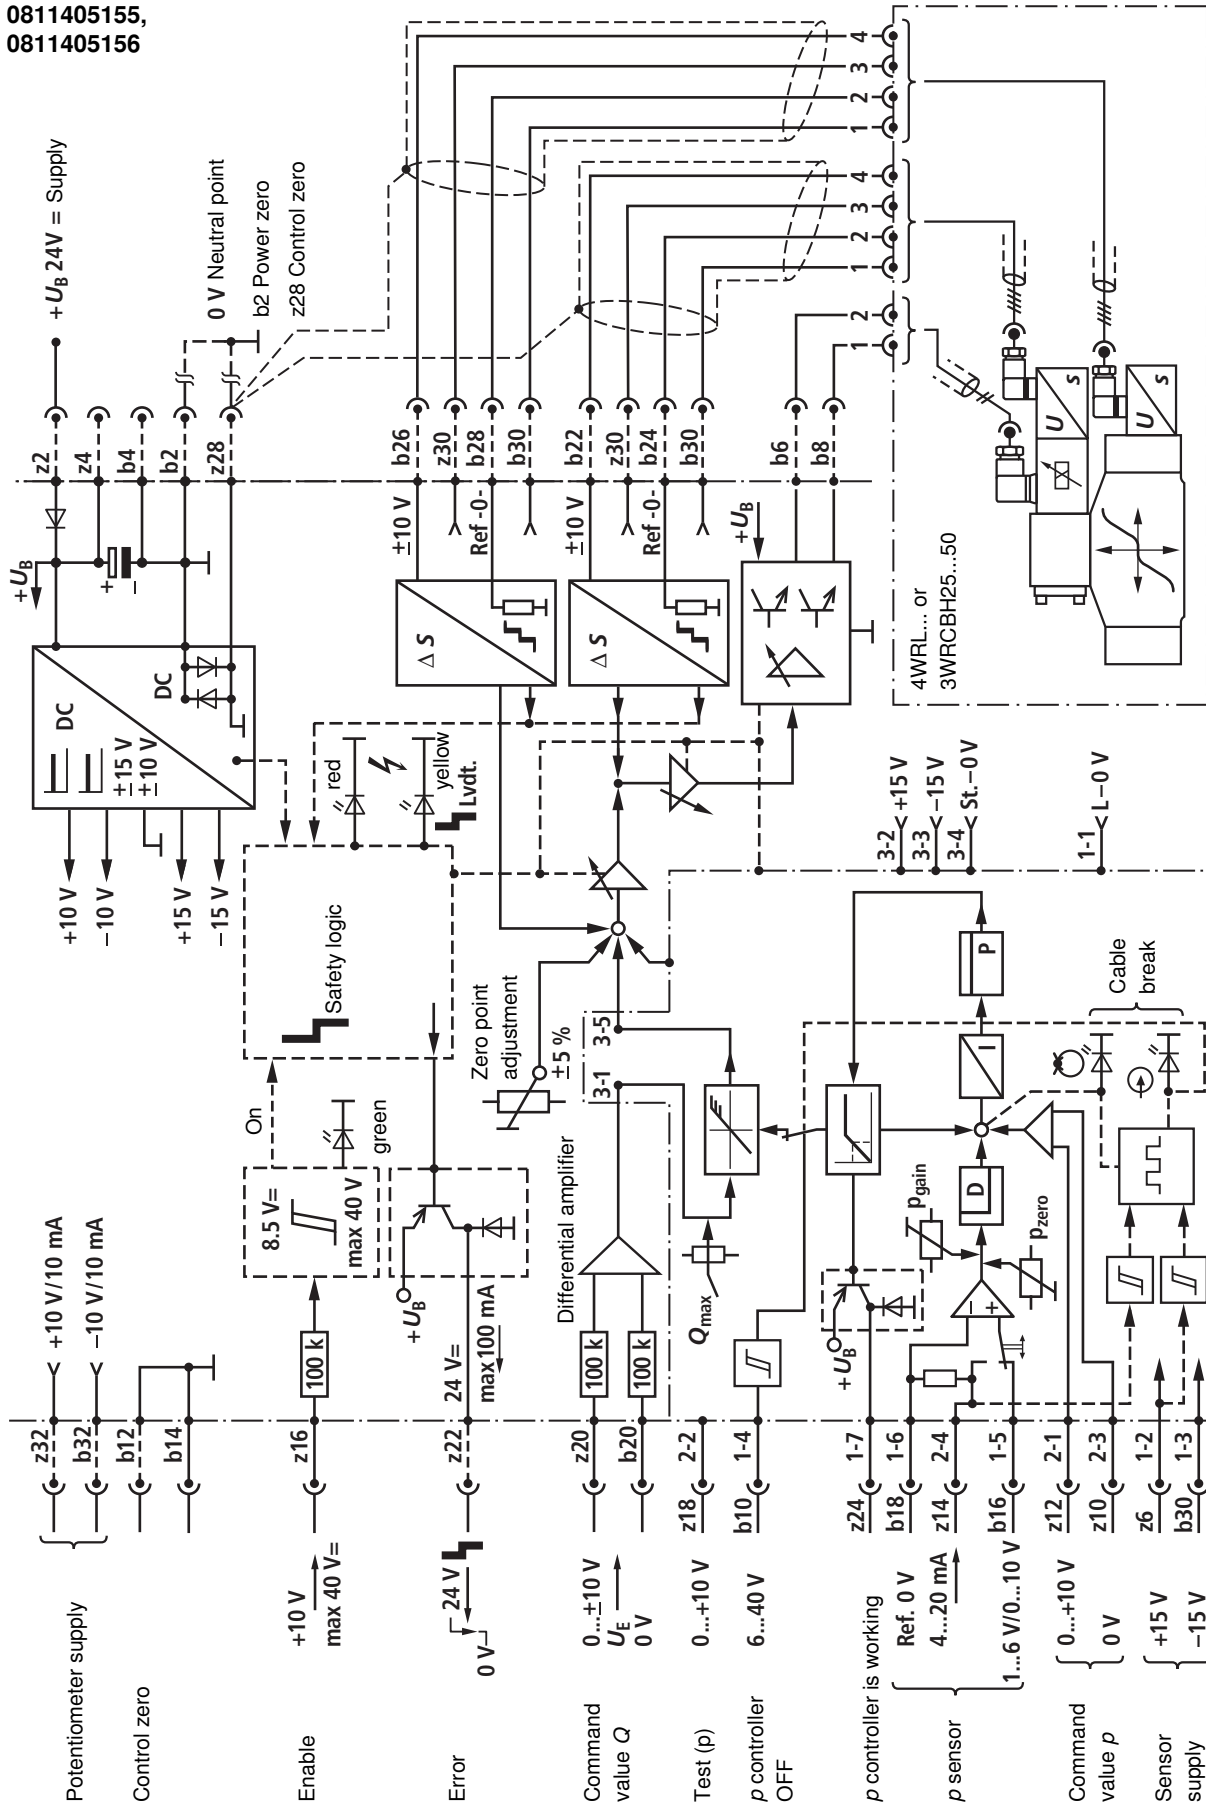

**Technical data** (For applications outside these parameters, please consult us!)

Supply voltage $U_B$ at z2 – b2	Nominal 24 V = Battery voltage 21...40 V, Rectified alternating voltage $U_{eff} = 21...28$ V (one-phase, full-wave rectifier)	
Smoothing capacitor, separately at z2 – b2	Recommendation: Capacitor module VT 11110 (see data sheet 30750) (only necessary if the ripple of $U_B > 10$ %)	
Valve solenoid, max.	A/VA	<b>2.7/40 (size 6)</b> <b>3.7/60 (size 10)</b>
Current consumption, max.	A	1.7      2.7
	The current consumption may increase with min. $U_B$ and extreme cable length to the control solenoid	
Power consumption (typical)	W	37      55
Input signal (command value)	b20: 0...±10 V } Differential amplifier z20: 0...±10 V } ( $R_i = 100$ k $\Omega$ )	
Input signal (command value p)	z12: 0...10 V } Differential amplifier z10: 0 V }	
Actual value from the pressure sensor	z14: 4...20 mA – Current input b16: 0...+10 V/1...+6 V – Voltage input b18: 0 V – Reference	
Pressure controller OFF	b10: 6...40 V =	
External enquiry pressure controller active	z24: 24 V/0.1 A max.	
Limit frequency	For applications $\leq 30$ Hz	
Signal source	Potentiometer 10 k $\Omega$ Supply with $\pm 10$ V from b32, z32 (10 mA) or external signal source	
Enable output stage	At z16, $U = 8.5...40$ V, $R_i = 100$ k $\Omega$ , LED (green) on front plate lights up	
Sensor supply	z6: +15 V/35 mA, $R_i \sim 25$ $\Omega$	
Position transducer	Supply	b30: –15 V (25 mA) z30: +15 V (35 mA)
Pilot control valve	Actual value signal	b22: 0...±10 V, $R_i = 10$ k $\Omega$ /Ref. b24
Main stage	Actual value reference	b26: 0...±10 V, $R_i = 10$ k $\Omega$ /Ref. b28
Solenoid output b6 – b8	$I_{max}$	Clocked current controller 2.7 A      3.7 A
Cable lengths between amplifier and valve	Solenoid cable:      up to 20 m 1.5 mm <sup>2</sup> 20 to 60 m 2.5 mm <sup>2</sup> Position transducer: 4 x 0.5 mm <sup>2</sup> (shielded) Pressure sensor:      4 x 0.5 mm <sup>2</sup> (shielded)	
Special features	Cable break protection for actual value cable, Position control with PID behavior, Pulsed output stage, Fast energization and fast deletion for short actuating times, Short-circuit-proof outputs, Controller shut-off	
Adjustment	Zero point via trimming potentiometer $\pm 5$ % Command value attenuator Q Pressure controller $K_p$ , $K_i$ and $K_D$ Sensitivity pressure load cell Zero point pressure load cell	
LED displays	green: Enable yellow: Cable break position transducer red: Supply voltage ( $U_B$ too low) yellow: Pressure controller OFF yellow: Pressure controller is working both yellow LEDs are flashing: Cable break pressure sensor	

## Technical data (For applications outside these parameters, please consult us!)

Error message		
- Cable break actual value		
- $U_B$ too low		
- $\pm 15$ V stabilization		z22: Open collector output to $+U_B$ Max. 100 mA; no error: $+U_B$
Circuit board format	mm	(100 x 160 x approx. 35) / (W x L x H) Europe format with front panel 7 TE
Plug-in connection		Connector DIN 41612 – F32
Ambient temperature	°C	0...+70
Storage temperature range	°C	-20...+70
Weight	m	0.49 kg

### Notice:

Power zero b2 and control zero b12 or b14 or z28 must be separately led to the central ground (neutral point).

## Additional information

### Applications

The  $p/Q$  closed-loop control amplifiers consist of a basic card with front plate containing the valve amplifier with position control as well as an attached daughter card on which the actual pressure control has been realized.

These amplifiers are only supplied as complete combinations. In connection with the corresponding high-response valves (see table page 2) and pressure sensors (sensor signal 1...6 V, 0...10 V or 4...20 mA), flows can be controlled and pressures in closed control loops can be regulated.

The input variables are the pressure  $p$  and flow  $Q$  command values. Pressure and valve spool path are fed back as actual values.

The combination of valve amplifier and  $p/Q$  controller takes effect:

- As long as  $p_{\text{command}} < p_{\text{actual}}$  as flow control, i.e. the pressure control does not take effect, yet.
- With  $p_{\text{command}} \geq p_{\text{actual}}$  as pressure control, i.e. the flow is reduced until  $p_{\text{actual}} = p_{\text{command}}$ . The pressure control works only with a positive command value voltage at z20.


The command value  $Q$  corresponds to the spool path as long as the pressure control does not take effect, yet, i.e.

$p_{\text{command}} > p_{\text{actual}}$  or if the pressure controller is switched off (DIL 4 OFF). The command value  $Q$  may range between  $U_E = 0... \pm 10$  V. For the dynamic pressure control there should, however, in addition to the command value  $p$  also be a command value  $Q_1$   $U_E \geq 2...+10$  V.

## Examples


### Example 1

Pressure control in a cylinder chamber for achieving a constant clamping force.

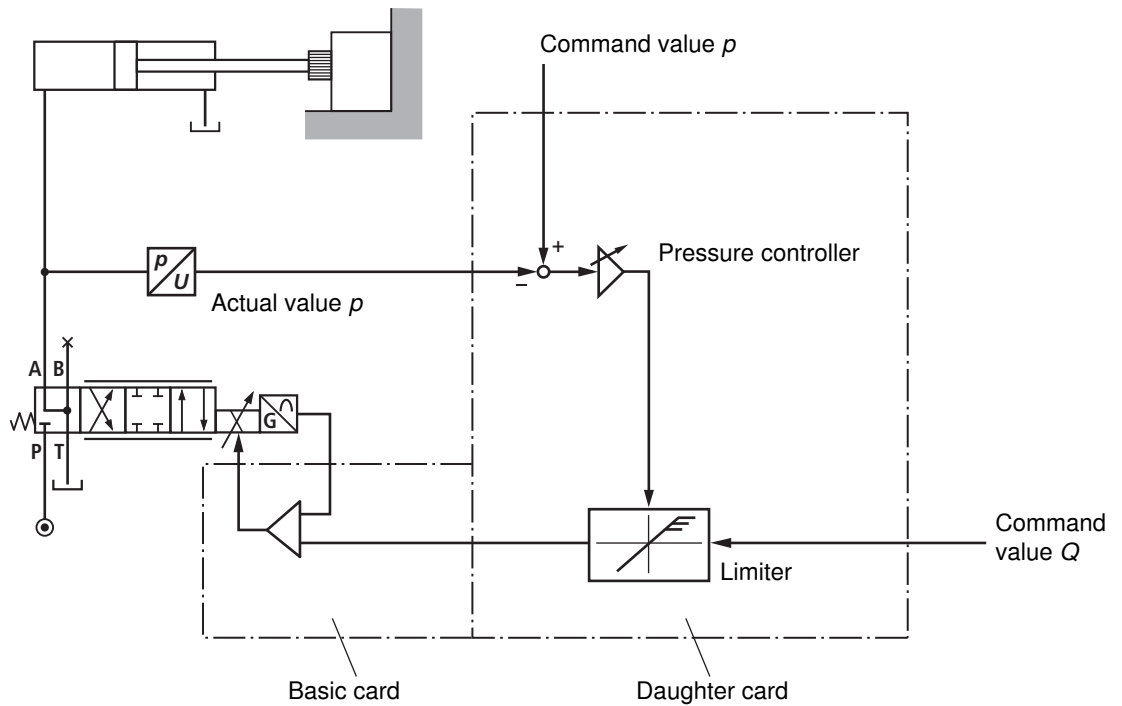

### Example 2

Flow with load compensation controlled via pressure compensator and the pressure regulated in the closed control loop (pressure cut off).

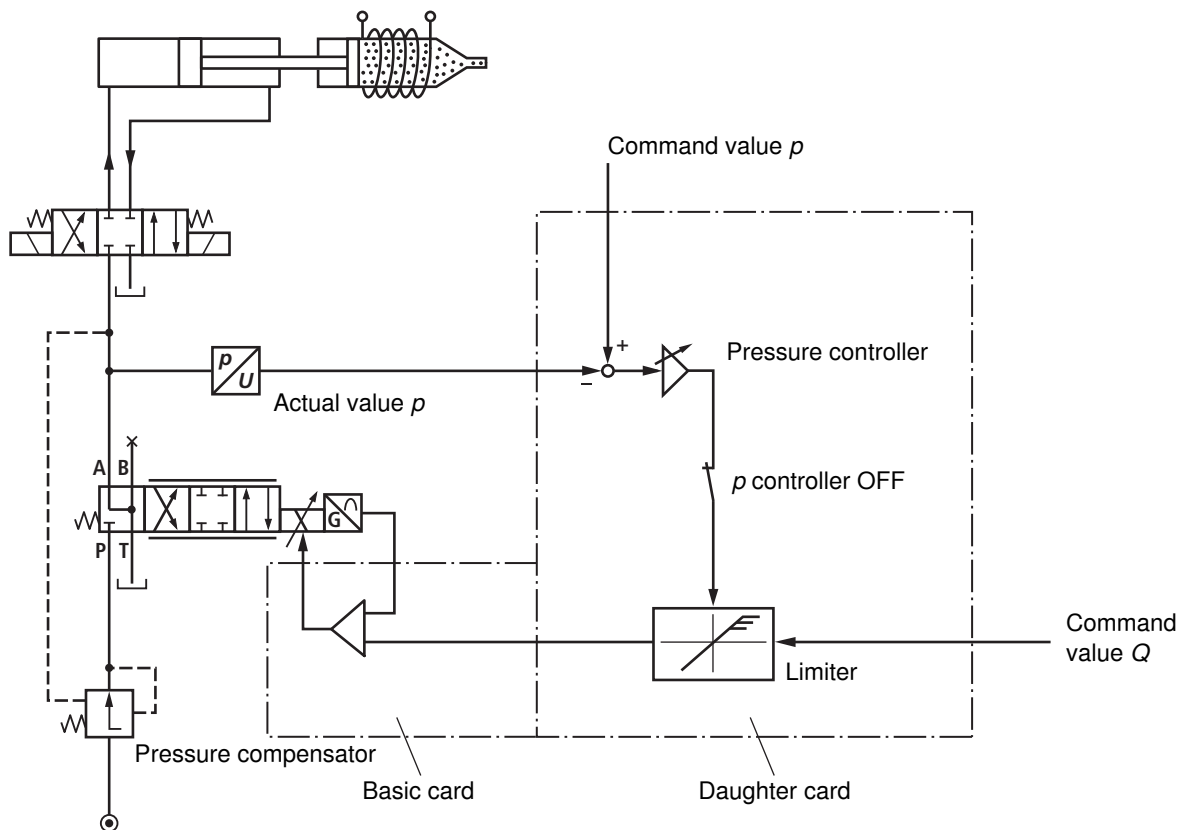

## Function

The combination of basic card and daughter card is shown in the block diagrams on page 3 and 4. Details of the daughter card, i.e. the pressure control, result from a detailed block diagram on page 9.

The command value  $p$  (z12) is specified by the user by a voltage 0...+10 V, e.g. by means of a potentiometer which can be supplied from z32/b12 (z10 to 0 V).

The actual value  $p$  is supplied by a pressure sensor. Optionally, sensors with current signal interface 4...20 mA or voltage signal interface 1...6 V and/or 0...10 V can be used. Zero point and sensitivity of the sensor can be set at the front plate. Cable break of the pressure sensor is signalized (LEDs flash) if the sensor is supplied at z6.


Command and actual value are compared in the summing point which is moreover affected by a differentiated actual value.

The control deviation is amplified by a PID controller and reaches a limiter superimposing the command value  $Q$  with the pressure controller signal if  $p_{\text{command}} \cong p_{\text{actual}}$ .


As long as  $p_{\text{command}} > p_{\text{actual}}$  or if the command value  $Q$  ranges between 0...-10 V, the limiter and thus the pressure control do not take effect and there is simple flow control.

The characteristic of the PID controller and the D element can be roughly set by means of the DIL switch on the daughter card and finely by means of the HEXCODE switch on the front plate. If the pressure is regulated, this condition is displayed on the front plate (LED) and can be used for switching purposes via an acknowledgement output (z24). However, the pressure control can also be switched off so that there is only flow control, independent of  $p_{\text{actual}}$ .

### Principle of the control loop

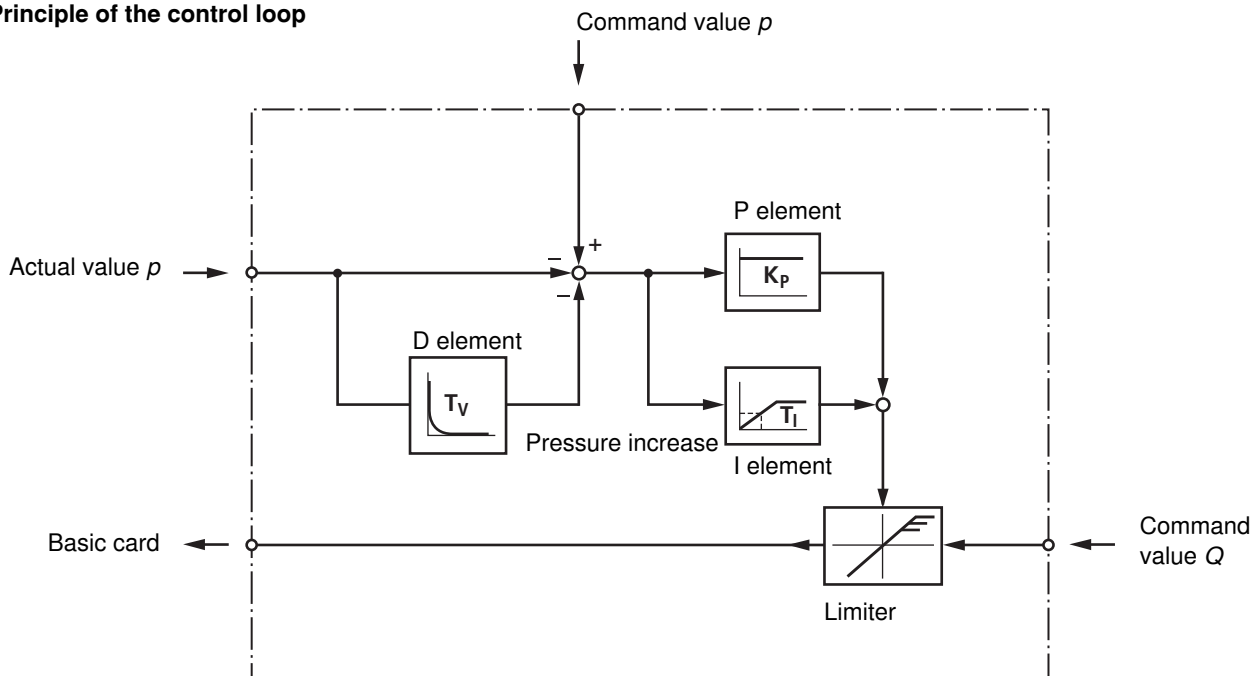


### Pressure sensor connection versions

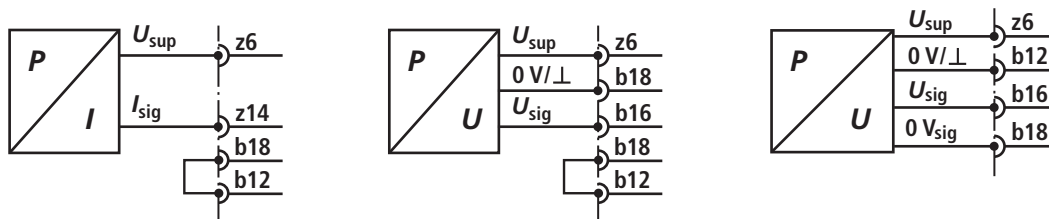




Block diagram daughter card

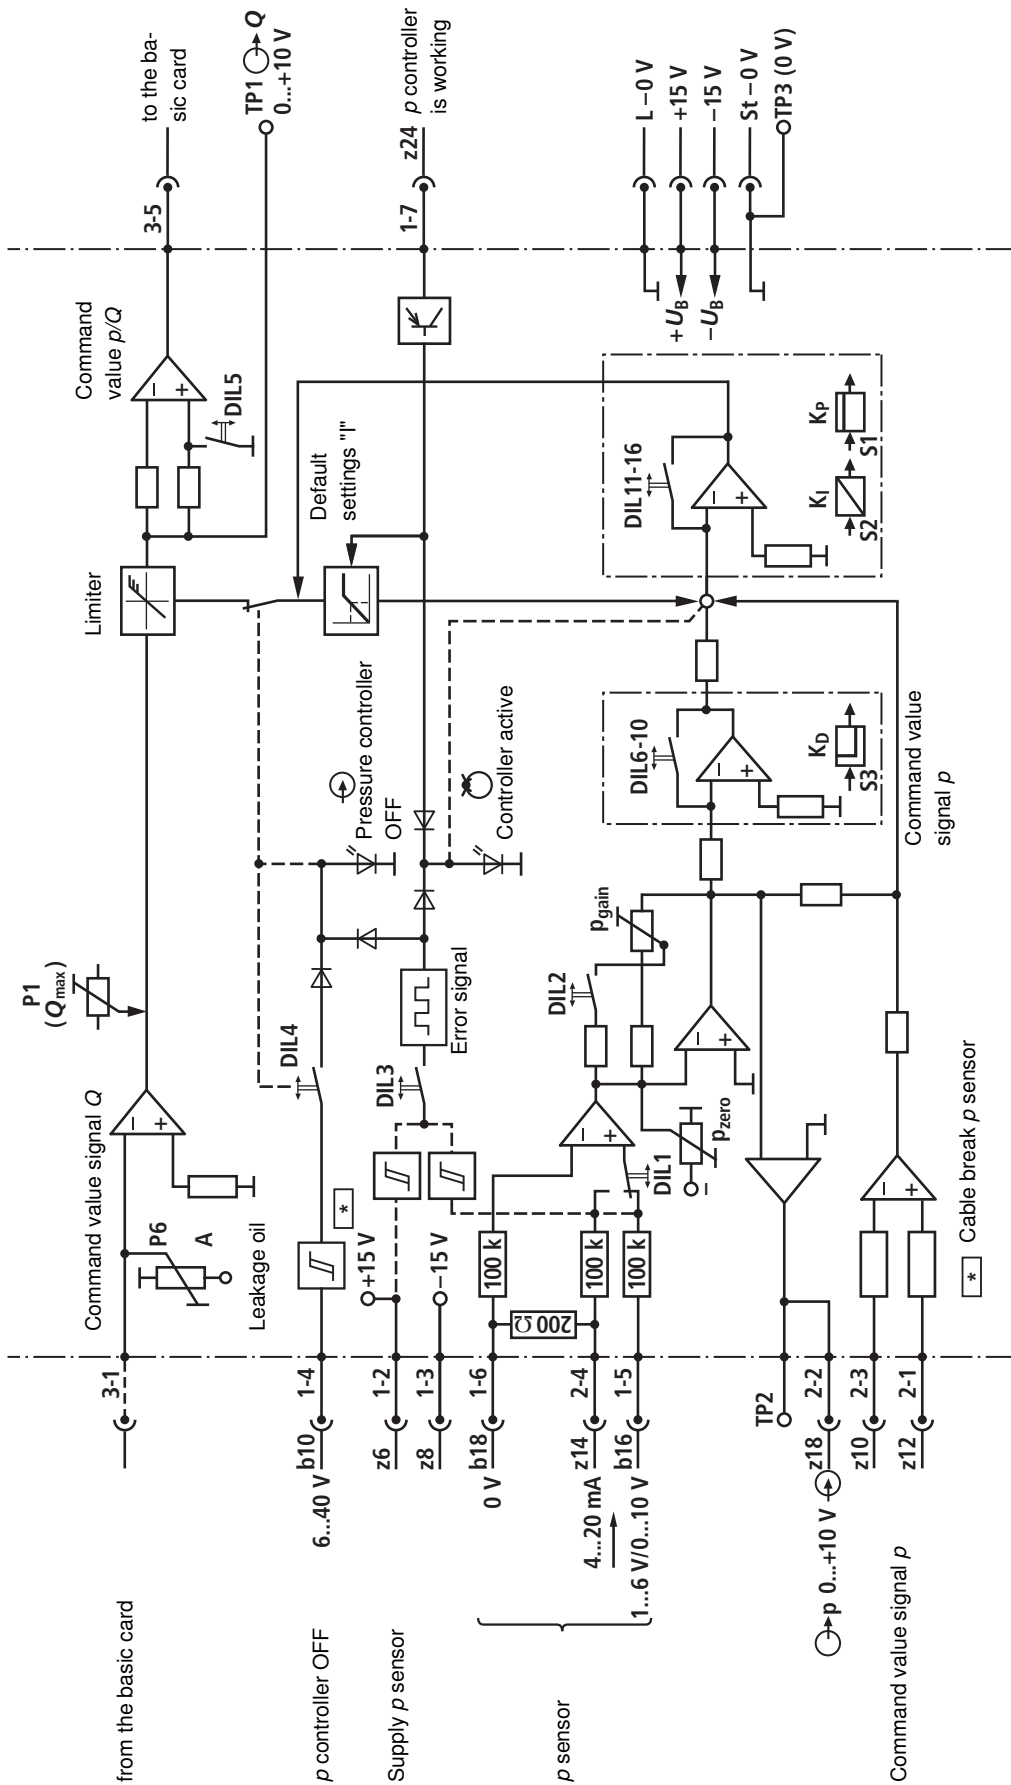

## Mode setting (DIL switch, daughter card)

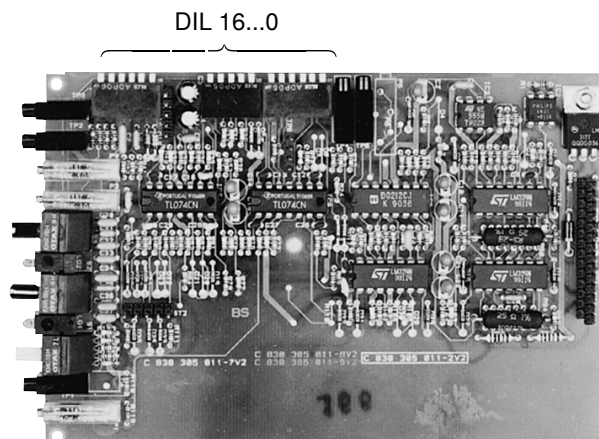

DIL no.	Status	Function
0	–	without function
1	ON	Pressure sensor signal
	OFF	1...6 V/0...10 V 4...20 mA
2	ON	Pressure sensor amplification
	OFF	$p_{SYS}^{2)} \triangleq \sim p_{NOM}^{3)}$ $p_{SYS} \triangleq \sim 0.5 p_{NOM}$
3	ON	Cable break monitoring
	OFF	On Off
4	ON	Pressure controller
	OFF	On Off
5	ON	Valve output signal
	OFF	not inverted inverted
6	ON	Pressure build-up
	OFF	
7	ON	D Pressure reduction
	OFF	
8	ON	Share high (9, 10 = OFF)
9	ON	Share medium (8, 10 = OFF)
10	ON	Share low (8, 9 = OFF)
11	ON	I Share = 0 (12 = OFF) Share available (11 = OFF)
12	ON	
13	ON	P Reduced pressure reduction
	OFF	
14	ON	Share low (16 = ON/15 = OFF)
15	ON	Share medium (14, 16 = OFF)
16	ON	Share high (14, 15 = OFF)

<sup>1)</sup> With DIL 6 and 7 = OFF, DIL 8...10 is ineffective

<sup>2)</sup>  $p_{SYS}$  = System pressure


<sup>3)</sup>  $p_{NOM}$  = Nominal sensor pressure

## General notes:

Setting during the commissioning is effected using potentiometers and HEXCODE switches on the front plate as well as using DIL switches on the daughter card bottom side. Test points for voltage measurements as well as LED displays are located on the front plate. The measured values generally refer to the test point 0 V. The test points may only be loaded with measuring instruments  $R_L \geq 10 \text{ k}\Omega$ . Overload impairs the control function and/or the printed circuit board is damaged.

Before the commissioning, the basic settings of the as-delivered state are to be checked.

In the card comparison, proceed in the order of the points shown:

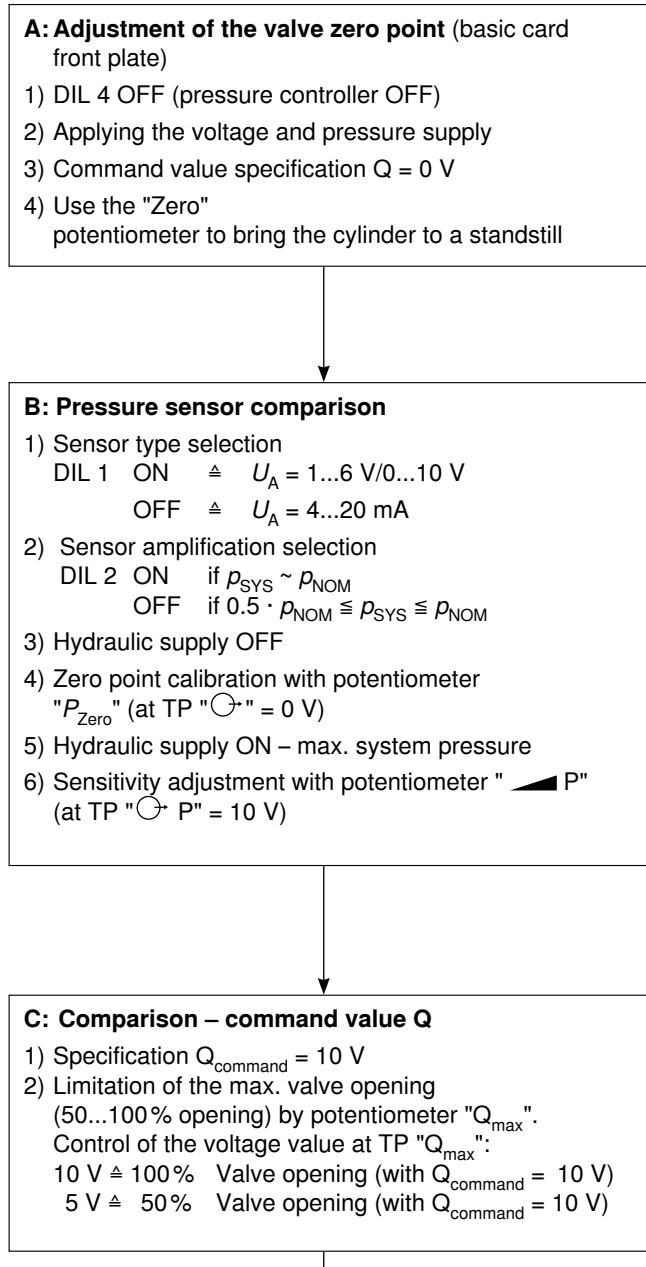

## D: Controller adjustment

The P, I and D shares of the closed-loop control amplifier are to be optimized according to the properties of the control distance, the disturbance variables and the static and dynamic requirements on the control result.

- 1) Pressure controller ON – DIL 4 ON
- 2) Connection of an oscilloscope at terminals z18 and b12 (0 V)  $\rightarrow p_{\text{actual}}$
- 3) Usefully connection of a 2nd oscilloscope channel at z2 and z10 (0 V)  $\rightarrow p_{\text{command}}$
- 4) DIL 6 and DIL 7 serve to compensate dynamic differences in the pressure build-up and reduction in the system
 

DIL 6	ON	= Normal application
	OFF	= Special application
DIL 7	ON	= Normal application
	OFF	= Special application
- 5) DIL 13 – reduces the pressure reduction by means of a valve opening < approx. 15%
 







ON	= Special application
OFF	= Normal application
- 6) **Aim of the controller optimization**  
 An optimum between change over characteristic (overshooting tendency with excessive static amplification) and static accuracy (control error with starting pressure cut off) is to be achieved (a).

**Procedure** (see table, page 12)

An increase in the P share of the controller increases the dynamic of the control behavior (b). In case of excessive gain, the tendency to oscillate increases (c). Limitation of the I share reduces the static gain. With increasing static gain, the control deviation is reduced (d).

The D share can be used to influence the transition behavior (minimization of the tendency to oscillate); thus, the command value is only reached after a longer transition time (f).

## Ideal development
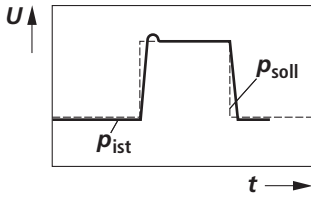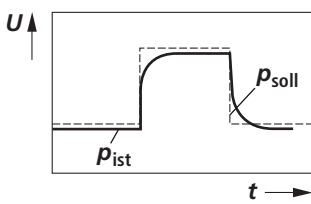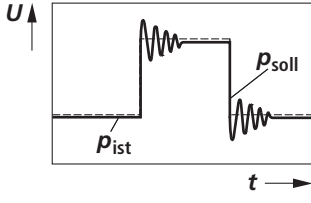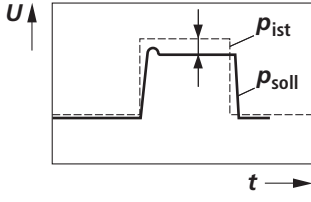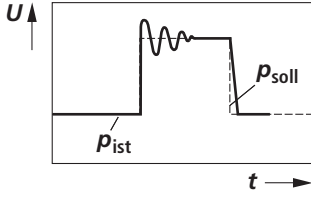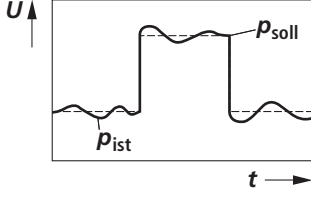
<p>a</p> 							
<p>b</p> 	<p><b>Problem:</b> P share too small</p> <p><b>Solution:</b></p> <ul style="list-style-type: none"> <li>→ Rotate <math>K_p</math> against 13 (fine adjustment)</li> <li>→ P gain &gt;</li> </ul> <table border="1" data-bbox="877 716 1053 806"> <tbody> <tr> <td>DIL 14</td> <td>ON</td> </tr> <tr> <td>DIL 15</td> <td>OFF</td> </tr> <tr> <td>DIL 16</td> <td>ON</td> </tr> </tbody> </table>	DIL 14	ON	DIL 15	OFF	DIL 16	ON
DIL 14	ON						
DIL 15	OFF						
DIL 16	ON						
<p>c</p> 	<p><b>Problem:</b> P share too large</p> <p><b>Solution:</b></p> <ul style="list-style-type: none"> <li>→ Rotate <math>K_p</math> against 0 (fine adjustment)</li> <li>→ use DIL 14 -16 to reduce the P gain according to the table</li> </ul>						
<p>d</p> 	<p><b>Problem:</b> P share correct, control deviation too large</p> <p><b>Solution:</b></p> <ul style="list-style-type: none"> <li>→ Increase the I gain share</li> <li>→ DIL 11 ON = I share = 0</li> <li>→ DIL 12 ON = I share connected</li> <li>→ Rotate <math>K_i</math> against 13</li> </ul>						
<p>e</p> 	<p><b>Problem:</b> Time constant of the I share too low</p> <p><b>Solution:</b></p> <ul style="list-style-type: none"> <li>→ Rotate <math>K_i</math> against 13 until control deviation and vibration are perfect</li> <li>→ If <math>K_i = 13</math> is not sufficient, the P share must also be reduced</li> </ul>						
<p>f</p> 	<p><b>Problem:</b> D share too low</p> <p><b>Solution:</b></p> <ul style="list-style-type: none"> <li>→ Rotate <math>K_D</math> against 13</li> <li>→ D share &gt;</li> </ul> <table border="1" data-bbox="877 1859 1053 1948"> <tbody> <tr> <td>DIL 8</td> <td>ON</td> </tr> <tr> <td>DIL 9</td> <td>OFF</td> </tr> <tr> <td>DIL 10</td> <td>OFF</td> </tr> </tbody> </table>	DIL 8	ON	DIL 9	OFF	DIL 10	OFF
DIL 8	ON						
DIL 9	OFF						
DIL 10	OFF						

### Adjustment protocol


Created by:

\_\_\_\_\_


Date:

\_\_\_\_\_

DIL switch




HEXCODE switch



Switches	As-delivered state		
	↓		
DIL 1	OFF		
DIL 2	ON		
DIL 3	ON		
DIL 4	ON		
DIL 5	OFF		
DIL 6	OFF		
DIL 7	OFF		
DIL 8	OFF		
DIL 9	OFF		
DIL 10	OFF		
DIL 11	OFF		
DIL 12	OFF		
DIL 13	OFF		
DIL 14	OFF		
DIL 15	ON		
DIL 16	OFF		
HEX K <sub>p</sub>	3		
HEX K <sub>i</sub>	9		
HEX K <sub>D</sub>	5		

## Unit dimensions (dimensions in mm)

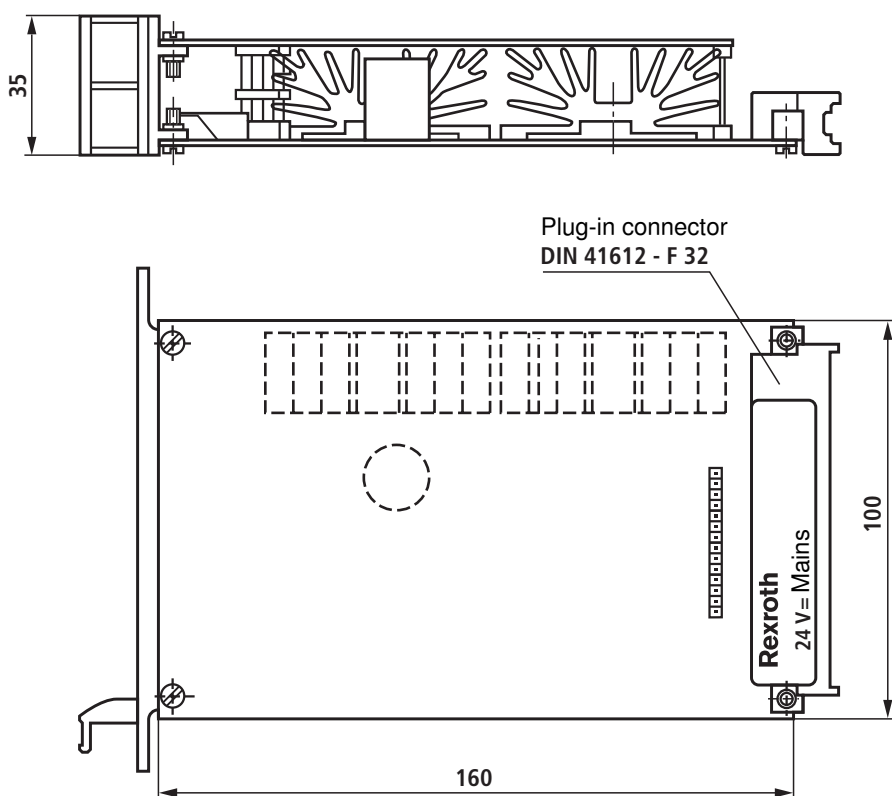

## Project planning / maintenance instructions / additional information

- The amplifier card may only be unplugged and plugged when de-energized.
- The distance to aerial lines, radios and radar systems must be sufficient (> 1 m).
- Do not lay solenoid and signal lines near power cables.
- For signal lines and solenoid conductors, we recommend using shielded cables.  
The cable shield must be connected to the control cabinet extensively and as short as possible.
- The valve solenoid must not be connected to free-wheeling diodes or other protective circuits.
- The cable lengths and cross-sections specified on page 5 must be complied with.

## Notes

---

Bosch Rexroth AG  
Hydraulics  
Zum Eisengießer 1  
97816 Lohr am Main, Germany  
Phone +49 (0) 93 52 / 18-0  
documentation@boschrexroth.de  
www.boschrexroth.de

© This document, as well as the data, specifications and other information set forth in it, are the exclusive property of Bosch Rexroth AG. It may not be reproduced or given to third parties without its consent. The data specified above only serve to describe the product. No statements concerning a certain condition or suitability for a certain application can be derived from our information. The information given does not release the user from the obligation of own judgment and verification. It must be remembered that our products are subject to a natural process of wear and aging.

## Notes

---